


Near Boiler Piping List

Item #	Description	Length	Quantity Required
1	2" NPT, Nipple	4"	3
2	2" NPT, Tee	-	4
3	2" NPT, Nipple	2-1/2"	3
4	2" NPT, Cap	-	2
5	2" NPT, Nipple	5"	2
6	2" NPT, Union	-	2
7	2" NPT, Elbow	-	4
8	2" NPT, Nipple	10"	2
9	2" NPT, Nipple	Close	1
10	2" x 1-1/2" NPT, Reducing Coupling	-	1
11	1-1/2" NPT, Nipple	12"	1
12	1-1/2" NPT, Union	-	2
14	1-1/2" NPT, Tee	-	2
15	1-1/2" NPT, Nipple	5-1/2"	1
16	1-1/2" NPT, Nipple	6"	2
17	2" x 1-1/2" NPT, Bushing	-	1
18	1-1/2" NPT, Nipple	Close	2
19	1-1/2" NPT, Cap	-	1
20	2" NPT, Nipple	8"	2
21	2" NPT, Nipple	8"	3
25	2" NPT, Nipple	22"	1

PEG150BIDE 5 Section Boiler Near Boiler Piping Kit

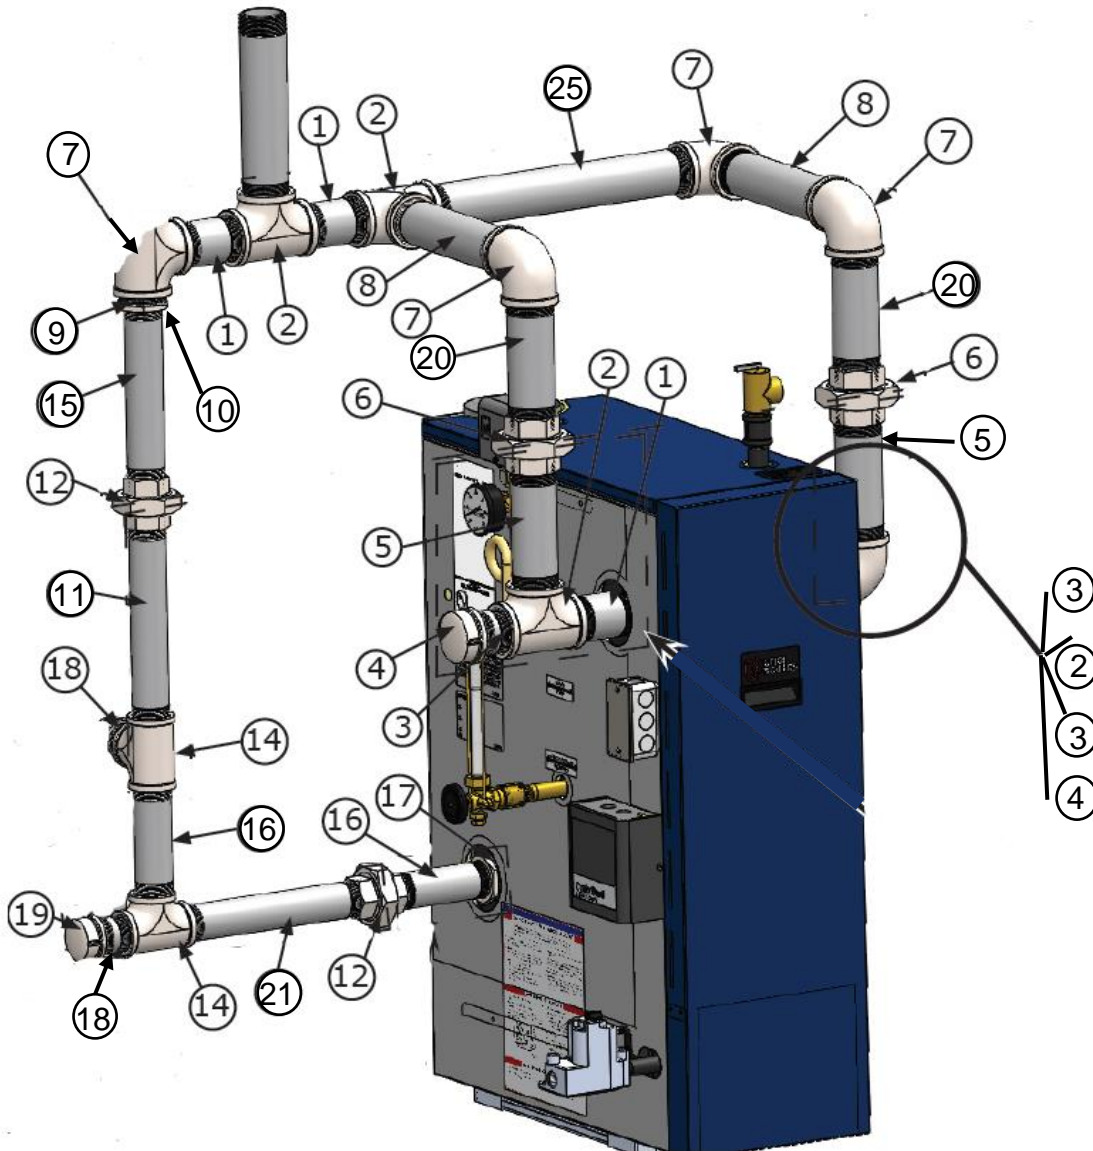

- All installations shall follow National/Local codes and requirements mentioned in boiler installation manual.
- It is recommended to apply Teflon tape and quality pipe dope on all threaded connections.
- Engagement depth for all piping is normally around $1\frac{9}{32}$ " per threaded connection.
- Engagement depth of threaded connection depends on quality and supplier of parts. Installer is responsible for making sure each connection is fully engaged, secure, and leak free.