

Instruction Sheet SR502 Switching Relay

102-082

POWER

ZONE 1 ZONE 2

120 VOLT

CIRCULATORS


SUPERSEDES: 102-082 December 1, 1999

EFFECTIVE: October 15, 2005

THERMOSTATS

00

00

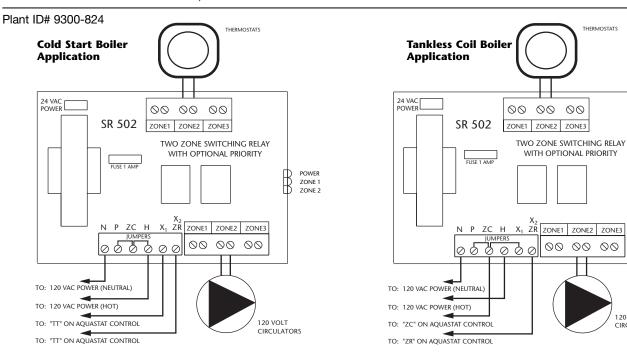

Note: When using Alternative Wiring diagram, the boiler operating control's ZC terminal will see the load of the circulator(s).

Warning: When using Alternative Wiring diagram, wiring instructions must be followed so power originates from the boiler aquastat. Failure to follow these wiring instructions may result in a secondary source of power being connected to the boiler that may activate it under certain circumstances, causing injury or death.

Operation: When the thermostat calls for heat, the appropriate circulator is energized and the isolated end switch (X₁ and X₂) will start the

Jumper Placement: The jumper should be placed between terminals ZC and H. Connect the isolated end switch, X₁ and X₂ to the boiler aquastat control. For zone 1 priority, remove jumper between terminals P and ZC.

Power Input: Connect 120 volt ac power input to terminals N and H. Neutral wire to terminal N. Hot wire to terminal H.

The Taco Connection:

Combine the reliability of the Taco Zone Valves, Priority Zoning Circulators, Thermostats, and the "00" family of circulators with the advanced features of the Taco Zone Controls to achieve total system integration. No matter the application, Taco now provides the products to maximize system performance while simplifying both installation and service.

External Diagnostics:

Externally visible lights show full functionality of the switching relay. The green light should always be on, indicating that power is connected. When the thermostat calls for heat, both the appropriate circulator and red indicating light is energized.

Specifications:

PRODUCT	NUMBER	TRANSFORMER	MAXIMUM	DIMENSIO		CLOSURE
NUMBER	OF ZONES	VOLTAGE	COMBINED LOAD	WIDTH		DEPTH
SR502	2 with Priority	120 VAC Input	15 amps	10 1/4"	6 3/4"	2 3/4"

All Switching Relays are relay type DPST, have a thermostat current of .18, and have a single phase motor rating per zone of 1/3 hp (7.2A) @ 120 VAC.

Operation: When any thermostat calls for heat, the boiler and appropriate circulator are energized when the boiler temperature is above the

Jumper Placement: A jumper should be placed between terminals ZC and X₁. Connect terminal ZC to ZC terminal on the aquastat control. Connect terminal ZR to ZR terminal on the aquastat control. Confirm polarity is consistent between boiler aquastat and switching relay. For zone 1 priority, remove jumper between terminals P and ZC.

Power Input: Connect 120 volt ac power input to terminals N and H. Neutral wire to terminal N. Hot wire to terminal H.

External Indicator Lights

Priority

Simplified Wiring

Fully Enclosed Snap-Out Relays

Compact Design Fuse Protected 100% Factory Tested Isolated End Switch

Contractor Friendly PC Board Layout Universal Thermostat Compatibility

UL Approved

24 volt Power Input or Output Terminal

Extended 3 Year Warranty

Made in the USA

Warning: Wiring connections must be made in accordance with all applicable electrical codes and these instructions. Use copper wire only. Failure to follow this instruction can result in personal injury or death and/or property damage. 10-18 gauge wire recommended for 120 VAC connections with 9 in.lbs. max torque, 12-22 gauge wire for thermostat connections with 9 in.lbs. max torque, and 12-22 gauge wire for 24 VAC source with 5 in.lbs. max torque.

Do it Once. Do it Right.

TACO, INC., 1160 Cranston Street, Cranston, RI 02920 Telephone: (401) 942-8000 FAX: (401) 942-2360. TACO (Canada), Ltd., 6180 Ordan Drive, Mississauga, Ontario L5T 2B3. Telephone: 905/564-9422. FAX: 905/564-9436.

Visit our web site at: http://www.taco-hvac.com

Printed in USA Copyright 2005 TACO, Inc.